


# REINFORCED CONCRETE PIPE JOINT TREATMENTS


FILTER FABRIC  
SECURED IN PLACE

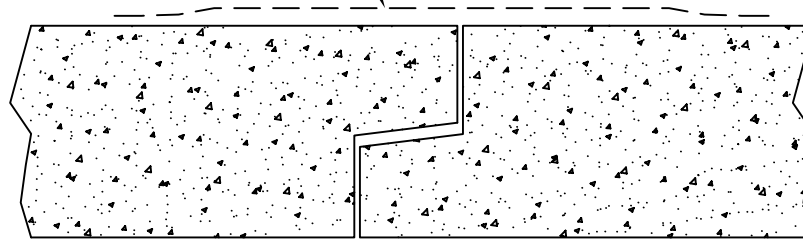

INSIDE SURFACE

## GEOTEXTILE FABRIC

PER AASHTO M-288, TYPE II

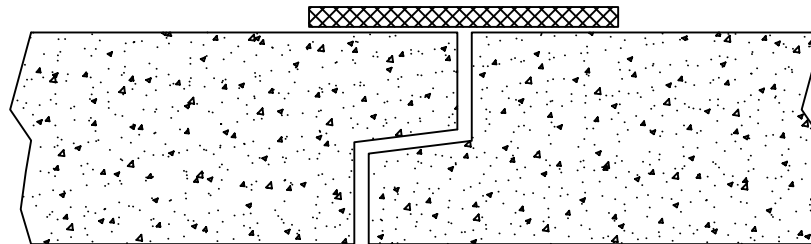


INSIDE SURFACE

## EXTERNAL JOINT SEAL

PER ASTM C-877

1 1/4" CORD DIA.

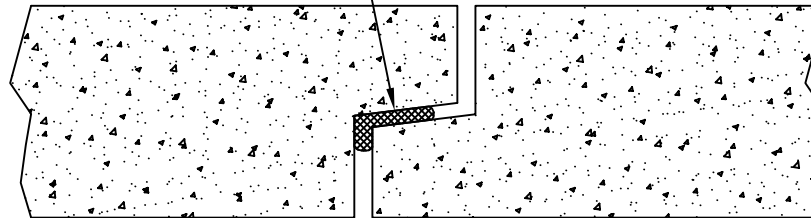

INSIDE SURFACE

## PREFORMED PLASTIC JOINT SEALANT

PER ASTM C-990

### Notes:

Joint may be sealed in other methods and must be approved by Forterra.

Copyright © 2016 Forterra Building Products  
All rights reserved. Information on this document is  
subject to change without notice.



**FORTERRA™**

[www.forterrapipelineandprecast.com](http://www.forterrapipelineandprecast.com)

REINFORCED CONCRETE PIPE  
JOINT TREATMENTS

SCALE NOT TO SCALE DATE 6/1/2016 DWG. NO. RCPJOINT